# Craftart



JAPAN CERAMICS

26 Daisy Street
Revesby NSW 2212
P 02 9772 2088
E sales@japanceramics.com.au
japanceramics.com.au

# CRAFTART

## COLOURS, FORMATS & FINISHES

| MATT \| P3 | Ice | Desert | Cotto | Earth | Ash | Lead | Carbon |
|---|---|---|---|---|---|---|---|
| 200 x 200mm | ● | ● | ● | ● | ● | ● | ● |
| 200 x 200mm 3D Ringlet | ● | ● | ● | ● | | | |
| 200 x 200mm Leaf | ● | ● | ● | ● | | | |
| 75 x 230mm | ● | ● | ● | ● | | | |

FINISH: **MATT** | CATEGORY: PORCELAIN TILES | EDGE DETAIL: RECTIFIED | V RATING: V2



Colour variation is an inherent property of all kiln-fired products. Tiles supplied may vary from samples provided. All slip ratings are provided subject to the guidelines outlined in our terms and conditions.






75 x 230mm
CRACIC752 (matt)


200 x 200mm
CRAICL20 (matt)


200 x 200mm
CRAICD20 (matt)


200 x 200mm
CRAIC20 (matt)

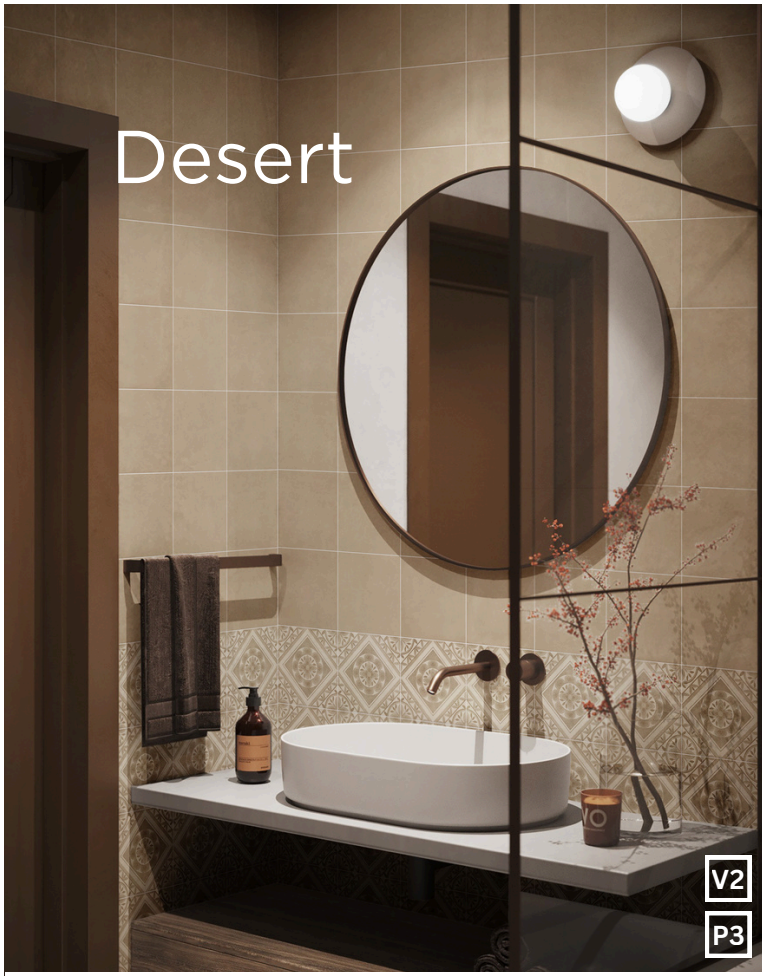



75 x 230mm
CRADE752 (matt)


200 x 200mm
CRADEL20 (matt)


200 x 200mm
CRADED20 (matt)


200 x 200mm
CRADE20 (matt)

JAPAN CERAMICS





75 x 230mm
CRACO752 (matt)

200 x 200mm
CRACOL20 (matt)

200 x 200mm
CRACOD20 (matt)

200 x 200mm
CRACO20 (matt)

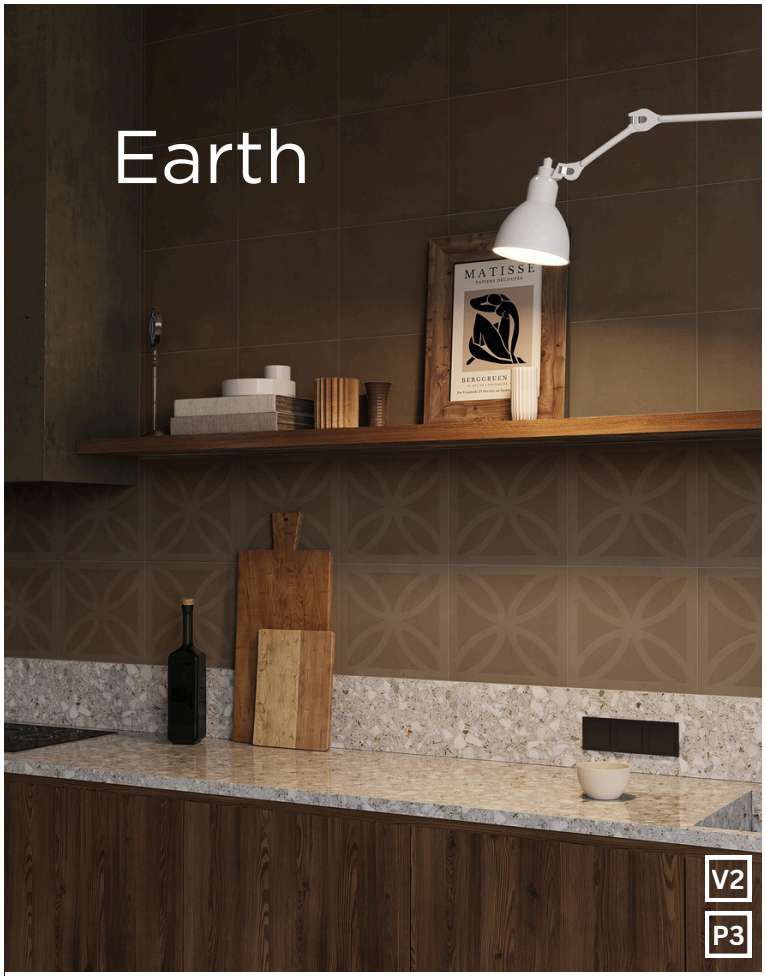


75 x 230mm
CRAEA752 (matt)

200 x 200mm
CRAEAL20 (matt)

200 x 200mm
CRAEAD20 (matt)

200 x 200mm
CRAEA20 (matt)

JAPAN CERAMICS







200 x 200mm
CRAAS20 (matt)






200 x 200mm
CRALD20 (matt)

JAPAN CERAMICS

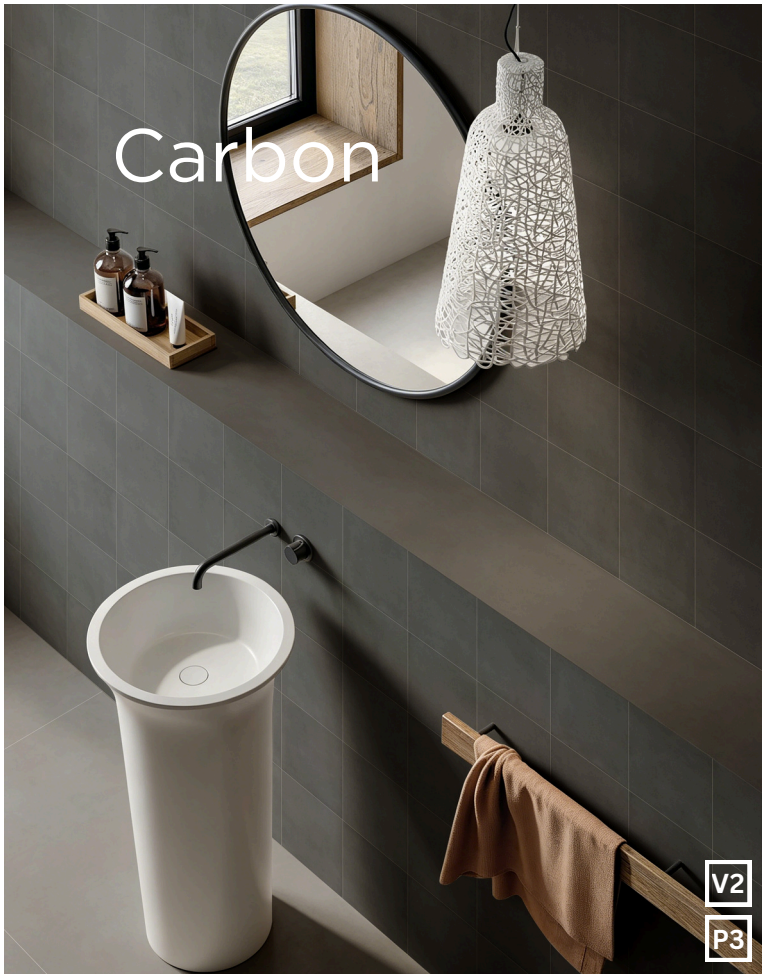




200 x 200mm
CRACB20 (matt)



JAPAN CERAMICS

# Technical Specifications

| Properties | Test Method | Required Value | Value | Applies to |
|---|---|---|---|---|
| Water absorption | GB/T 4100-2015 | ⩽ 0.5% | 2.20% | Full range |
| Breaking strength | GB/T 4100-2015 | 1100 N | 1585 N | Full range |
| Modulus of rupture | GB/T 4100-2015 | Minimum 35 MPa | 38 MPa | Full range |
| Abrasion resistance | GB/T 4100-2015 | As reported | Class 3 | Full range |
| Slip resistance (wet pendulum test) | AS 4586-2013/Amdt 12017 Appendix A | N/A | P3 - Matt | Matt |
| Chemical resistance | GB/T 4100-2015 | Minimum UB | GA, GLA, GHA | Full range |
| Stain resistance | GB/T 4100-2015 | Minimum class 3 | Class 5 | Full range |
| Origin | N/A | N/A | China | Full range |
| Shade variation | N/A | N/A | V2 | Full range |



JAPAN CERAMICS

# Packing Information

| Tile Description | | Quantity per Box | Quantity per m2 | | Quantity per Pallet | |
|---|---|---|---|---|---|---|
| Size (mm) | Finish | Pieces | Pieces | Weight | m2 | Boxes |
| 200 x 200 | Matt | 25 | 25.00 | 17.00 | 72.00 | 72 |
| 75 x 230 | Matt | 56 | 57.97 | 18.11 | 61.82 | 64 |




*The data and information contained in these specification sheets are indicative only unless stated otherwise. As Japan Ceramics cannot control the conditions under which these products are manufactured, the specifications supplied should be considered as suggested guidelines only and are subject to batch variation. The information contained in these specification sheets should not be considered a warranty, expressed or implied, including, but not limited to, a warranty of merchantability or fitness for a particular purpose. To the maximum extent permitted by law, ColorTile will not be responsible for damages of any nature resulting from the use or reliance upon the information contained in this data sheet. No express or implied warranties are given in respect of any specification provided herein other than those that cannot be excluded under the Australian Consumer Law.*

JAPAN CERAMICS

SafeEnvironments
MANAGING PROPERTY RISK

ilac-MRA NATA
Accreditation No. 17139

**IMPORTANT NOTE:**
**Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.**

# Slip Check to AS 4586-2013

# Craftart 200x200

**Report Number: R34074a**
**Report Date: 7 July 2025**
**Total Number of Pages 2**

Safe Environments quality management system is certified to ISO 9001:2015

Accredited for compliance with ISO/IEC 17025 – Testing

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates

This test report shall not be reproduced unless in full, without written approval of Safe Environments Pty Limited

**Issued by**

Safe Environments Pty Limited
6/7 Inglewood Place
Norwest NSW 2153

**Prepared for**

Japan Ceramics Pty Ltd
26 Daisy Street
Revesby NSW 2212

**Approved by**

Ratan Venkatesan
Authorised Signatory

SlipCheck
CREATING SAFE ENVIRONMENTS
www.FloorSlipTest.com.au

6/7 Inglewood Place
Norwest NSW 2153
Phone02 9621 3706
info@SafeEnvironments.com.au

7 July 2025

# Test Report No. R34074a

## Slip ResistanceClassificationofNewPedestrianSurface Materials

**AS 4586-2013 Appendix A (Wet Pendulum Test)**

The slip resistance classification has been determined for unused surfaces under specific conditions. Factors such as usage, cleaning systems, applied coatings and patterns of wear may affect the characteristics of the surface after classification. Standards Australia Handbook 198:2014 *Guide to the specification and testing of slip resistance of pedestrian surfaces* provides guidance for the selection of slip resistant pedestrian surfaces classified in accordance with AS 4586-2013. It is recommended that this test report be read in conjunction with AS 4586, HB 197 & HB 198.

| | |
|---|---|
| Requested by: | Japan Ceramics Pty Ltd |
| Client Address: | 26 Daisy Street<br>Revesby NSW 2212 |
| Product Manufacturer: | Max Glory |
| Product Description: | Craftart 200x200 |
| Test conducted according to: | AS 4586:2013 Appendix A |
| Sampling Procedures: | Performed by client and tested as received. |
| Location: | 6/7 Inglewood Place, Norwest NSW 2153 |
| Conducted by: | Ratan Venkatesan |
| Date: | 07 July 2025 |
| Sample: | Unfixed |
| Rubber slider used: | Slider 96 |
| Slope of specimen: | Tested on a flat level surface |
| Direction of Test: | N/A |
| Temperature: | 17°C |
| Cleaning: | None |
| Conditioned: | Grade P 400 paper dry followed by wet lapping film |

| | Specimen 1 | Specimen 2 | Specimen 3 | Specimen 4 | Specimen 5 |
|---|---|---|---|---|---|
| Mean BPN of last 3 swings: | 37 | 40 | 35 | 37 | 40 |

| | |
|---|---|
| **Reported SRV of Sample:** | **38** |
| **Class:** | **P3** |

The expanded uncertainty ($U_{95}$) at the 95% level of confidence with a coverage factor (k) of 2 has been estimated to be 3 BPN or 8%, whichever is the greater; sampling uncertainty has not been included. The expanded uncertainty should be considered when interpreting results or assessing conformity. Results relate only to items tested.

This test report shall not be reproduced unless in full, without written approval of Safe EnvironmentsPtyLtd