Dural



JAPAN CERAMICS

26 Daisy Street
Revesby NSW 2212
P 02 9772 2088
E sales@japanceramics.com.au
japanceramics.com.au

DURAL

COLOURS, FORMATS & FINISHES

Matt	Dune	 Cotto	Shale Grey	 Eucalypt	 Blue Gum	 Monument
300 x 300mm	●	●	●	●	●	●

FINISH: **MATT** | CATEGORY: PORCELAIN TILES | EDGE DETAIL: UNRECTIFIED | V RATING: V1





300 x 300mm
DURDU30 (matt)






300 x 300mm
DURCO30 (matt)

JAPAN CERAMICS



300 x 300mm
DURSG30 (matt)

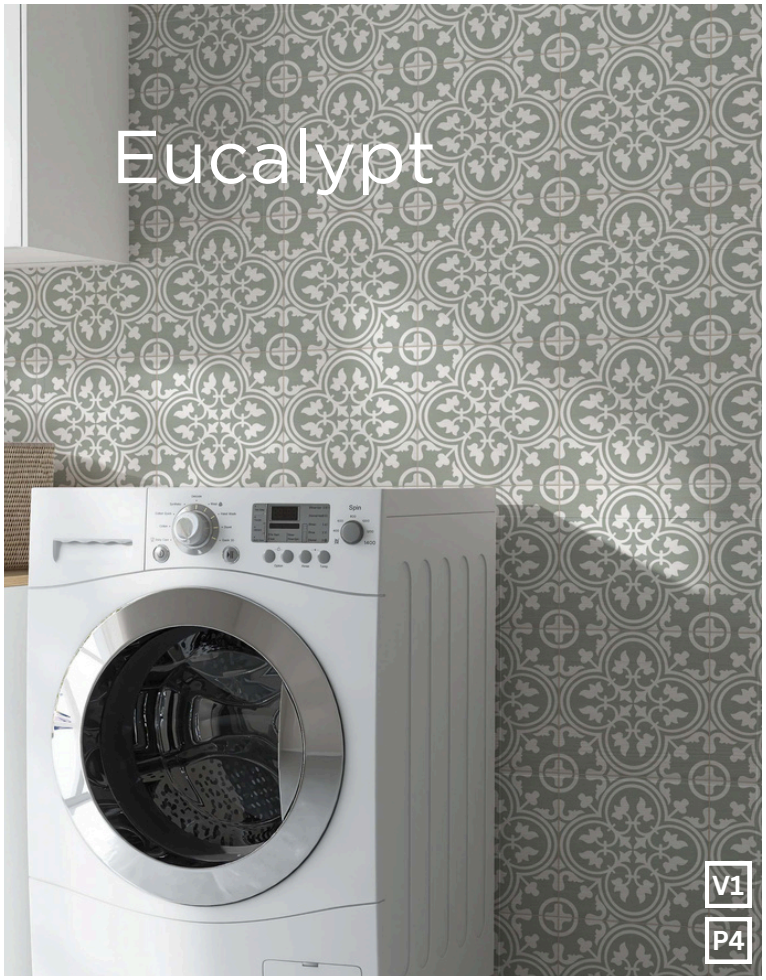




300 x 300mm
DUREU30 (matt)

JAPAN CERAMICS





300 x 300mm
DURBG30 (matt)

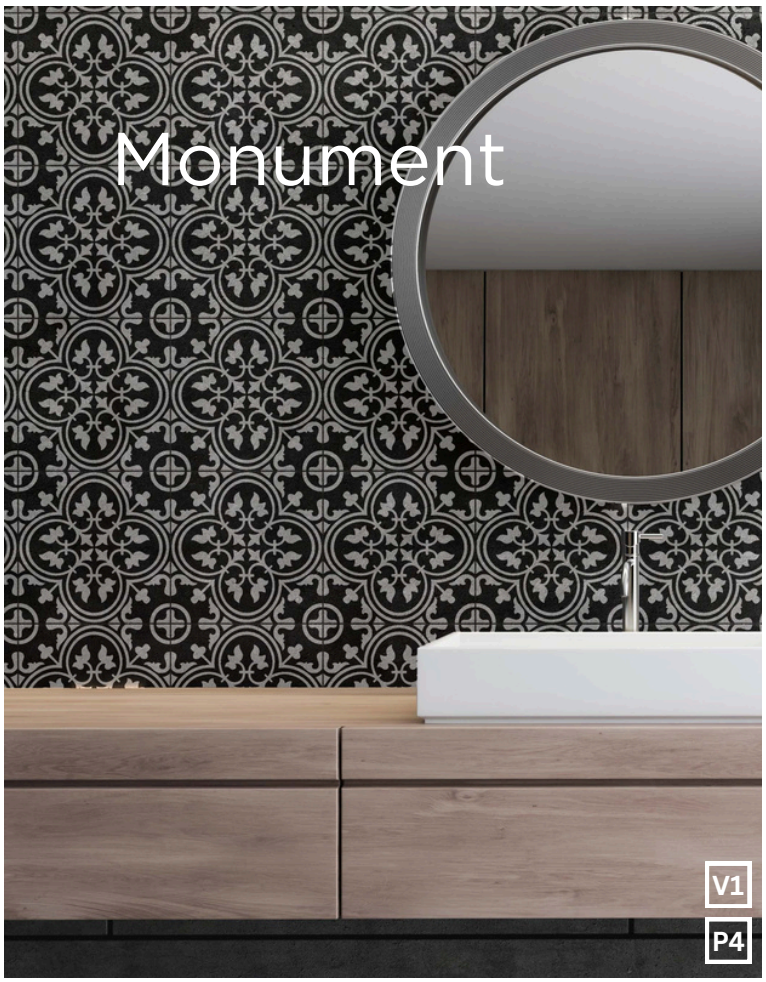



300 x 300mm
DURMO30 (matt)

JAPAN CERAMICS

Technical Specifications

Properties	Test Method	Required Value	Value	Applies to
Water absorption	ISO 10545-3	⩽ 0.5%	⩽ 3%	All finishes
Determination of dimensions	ISO 10545-2	Length and width ± 0.5% Thickness ± 5.00% Edge straightness ± 0.5% Surface flatness ± 5%	Length and width 0.5% Thickness 5.0% Edge straightness 0.6% Surface flatness 0.5%	All finishes
Breaking strength	ISO 10545-4	⩾ 12 N/mm	30 N/mm	All finishes
Abrasion resistance	ISO 10545-6	Class 3 min	Complies with standards	All finishes
Slip resistance (wet pendulum test)	AS4586-2013	N/A	Matt - P4	Full range
Chemical resistance	ISO 10545-13	GB min.	Complies with standards	All finishes
Stain resistance	ISO 10545-14	Class 3 min.	Complies with standards	All finishes
Origin	N/A	N/A	Australia	Full range
Shade variation	N/A	N/A	V1	Full range



JAPAN CERAMICS

Packing Information

Tile Description		Quantity per Box	Quantity per m2		Quantity per Pallet	
Size (mm)	Finish	Pieces	Pieces	Weight	m2	Boxes
300 x 300	Matt	22	11.11	14.05kg	95.04	48



The data and information contained in these specification sheets are indicative only unless stated otherwise. As Japan Ceramics cannot control the conditions under which these products are manufactured, the specifications supplied should be considered as suggested guidelines only and are subject to batch variation. The information contained in these specification sheets should not be considered a warranty, expressed or implied, including, but not limited to, a warranty of merchantability or fitness for a particular purpose. To the maximum extent permitted by law, Japan Ceramics will not be responsible for damages of any nature resulting from the use or reliance upon the information contained in this data sheet. No express or implied warranties are given in respect of any specification provided herein other than those that cannot be excluded under the Australian Consumer Law.

JAPAN CERAMICS

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Test Report – Product Certification

Sample Number	2606040818	**TestSheetNumber**	YDU13422A-260604	**Date of Test**	05/06/2026
Tile Name	~~Dural Dune P4~~ (Size: 300×300×6.3 mm)	**Tile Code**	YDU13422A	**Report Number**	R260041
Tile Manufacturer	National Ceramic Industries Australia (NCIA) www.ncia.com.au		**ABN**	83 100 467 267	
Address	175 Racecourse Rd, Rutherford, NSW 2320		**Phone**	02 4931 8400	

Testing performed in Accordance with AS4586-2013 Amd 1:2017, Appendix A Wet Pendulum Test Method with a 96 Rubber slider, conditioned with P400C paper dry, followed by 3 µm wet lapping film

Temperature (Laboratory):	20.0°C	**Testing Instrument:**	Pendulum Friction Tester (Munro Stanley Portable Skid Resistance Tester S/N: 2081) Calibration Date: 18 December 2025

Test Specimen (Unfixed)	**Slope of Surface**	**Cleaning Pre-testing**	**Pendulum Swing Results (BPN)**					**Mean (BPN)** (last3swings)	**Classification According to AS4586-2013**	
			1	**2**	**3**	**4**	**5**			
Tile 1	Flat and level surface	Water & Scrubbing	49	49	49	49	49	49	**P4**	
Tile 2	Same as above	Water & Scrubbing	49	49	48	48	48	48		
Tile 3	Same as above	Water & Scrubbing	46	46	46	46	46	46		
Tile 4	Same as above	Water & Scrubbing	47	47	47	47	47	47	**Reported Slip Resistance Value of Sample (BPN)**	48
Tile 5	Same as above	Water & Scrubbing	49	49	49	49	49	49		

Slope Correction Value (SCV) = No
Results relate only to the items tested

Test Location:	NCIA Tile Testing Laboratory, 175 Racecourse Rd, Rutherford, NSW, 2320 Australia		
Report Issued by:	NCIA Pendulum Friction Tester Laboratory	**Issue Date:**	05/06/2026
Test Officer	Hong Lu	**Authorised by:**	Hong Lu

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Test Report – Product Certification

Sample Number	2606041937	**TestSheetNumber**	YDU12022A-260604	**Date of Test**	04/06/2026
Tile Name	~~Dural Shale Grey P4~~ (Size: 300×300×6.3 mm)	**Tile Code**	YDU12022A	**Report Number**	R260039
Tile Manufacturer	National Ceramic Industries Australia (NCIA) www.ncia.com.au		**ABN**	83 100 467 267	
Address	175 Racecourse Rd, Rutherford, NSW 2320		**Phone**	02 4931 8400	

Testing performed in Accordance with AS4586-2013 Amd 1:2017, Appendix A Wet Pendulum Test Method with a 96 Rubber slider, conditioned with P400C paper dry, followed by 3 µm wet lapping film

Temperature (Laboratory):	20.3°C	**Testing Instrument:**	Pendulum Friction Tester (Munro Stanley Portable Skid Resistance Tester S/N: 2081) Calibration Date: 18 December 2025

Test Specimen (Unfixed)	**Slope of Surface**	**Cleaning Pre-testing**	**Pendulum Swing Results (BPN)**					**Mean (BPN)** (last3swings)	**Classification According to AS4586-2013**	
			1	**2**	**3**	**4**	**5**			
Tile 1	Flat and level surface	Water & Scrubbing	47	47	47	47	47	47	**P4**	
Tile 2	Same as above	Water & Scrubbing	50	50	50	50	50	50		
Tile 3	Same as above	Water & Scrubbing	49	49	49	49	49	49		
Tile 4	Same as above	Water & Scrubbing	50	50	50	50	50	50	**Reported Slip Resistance Value of Sample (BPN)**	49
Tile 5	Same as above	Water & Scrubbing	47	47	47	47	47	47		

Slope Correction Value (SCV) = No
Results relate only to the items tested

Test Location:	NCIA Tile Testing Laboratory, 175 Racecourse Rd, Rutherford, NSW, 2320 Australia		
Report Issued by:	NCIA Pendulum Friction Tester Laboratory	**Issue Date:**	04/06/2026
Test Officer	Hong Lu	**Authorised by:**	Hong Lu

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Test Report – Product Certification

Sample Number	2606040332	**TestSheetNumber**	YDU13322A-260604	**Date of Test**	04/06/2026
Tile Name	~~Dural Cotto P4~~ (Size: 300×300×6.3 mm)	**Tile Code**	YDU13322A	**Report Number**	R260040
Tile Manufacturer	National Ceramic Industries Australia (NCIA) www.ncia.com.au		**ABN**	83 100 467 267	
Address	175 Racecourse Rd, Rutherford, NSW 2320		**Phone**	02 4931 8400	

Testing performed in Accordance with AS4586-2013 Amd 1:2017, Appendix A Wet Pendulum Test Method with a 96 Rubber slider, conditioned with P400C paper dry, followed by 3 µm wet lapping film

Temperature (Laboratory):	20.3°C	**Testing Instrument:**	Pendulum Friction Tester (Munro Stanley Portable Skid Resistance Tester S/N: 2081) Calibration Date: 18 December 2025

Test Specimen (Unfixed)	**Slope of Surface**	**Cleaning Pre-testing**	**Pendulum Swing Results (BPN)**					**Mean (BPN)** (last3swings)	**Classification According to AS4586-2013**	
			1	**2**	**3**	**4**	**5**			
Tile 1	Flat and level surface	Water & Scrubbing	48	48	48	48	~~48~~ 47	48	**P4**	
Tile 2		Water & Scrubbing	47	47	47	47	47	47		
Tile 3	Same as above	Water & Scrubbing	48	48	48	47	47	47		
Tile 4	Same as above	Water & Scrubbing	47	47	47	47	47	47	**Reported Slip Resistance Value of Sample (BPN)**	48
Tile 5	Same as above	Water & Scrubbing	49	49	49	49	49	49		

Slope Correction Value (SCV) = No
Results relate only to the items tested

Test Location:	NCIA Tile Testing Laboratory, 175 Racecourse Rd, Rutherford, NSW, 2320 Australia		
Report Issued by:	NCIA Pendulum Friction Tester Laboratory	**Issue Date:**	04/06/2026
Test Officer	Hong Lu	**Authorised by:**	Hong Lu

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Test Report – Product Certification

Sample Number	2606040957	**TestSheetNumber**	YDU15022A-260604	**Date of Test**	05/06/2026
Tile Name	~~Dural Blue Gum P4~~ (Size: 300×300×6.3 mm)	**Tile Code**	YDU15022A	**Report Number**	R260043
Tile Manufacturer	National Ceramic Industries Australia (NCIA) www.ncia.com.au		**ABN**	83 100 467 267	
Address	175 Racecourse Rd, Rutherford, NSW 2320		**Phone**	02 4931 8400	

Testing performed in Accordance with AS4586-2013 Amd 1:2017, Appendix A Wet Pendulum Test Method with a 96 Rubber slider, conditioned with P400C paper dry, followed by 3 µm wet lapping film

Temperature (Laboratory):	20.0°C	**Testing Instrument:**	Pendulum Friction Tester (Munro Stanley Portable Skid Resistance Tester S/N: 2081) Calibration Date: 18 December 2025

Test Specimen (Unfixed)	**Slope of Surface**	**Cleaning Pre-testing**	**Pendulum Swing Results (BPN)**					**Mean (BPN)** (last3swings)	**Classification According to AS4586-2013**
			1	**2**	**3**	**4**	**5**		
Tile 1	Flat and level surface	Water & Scrubbing	47	47	48	48	~~48~~	48	**P4**
Tile 2		Water & Scrubbing	48	48	48	48	~~48~~	48	
Tile 3	Same as above	Water & Scrubbing	45	45	45	45	~~45~~	45	
Tile 4	Same as above	Water & Scrubbing	47	47	47	47	~~47~~	47	**Reported Slip Resistance Value of Sample (BPN)** 47
Tile 5	Same as above	Water & Scrubbing	48	48	48	48	~~48~~	48	
	Same as above								

Slope Correction Value (SCV) = No
Results relate only to the items tested

Test Location:	NCIA Tile Testing Laboratory, 175 Racecourse Rd, Rutherford, NSW, 2320 Australia		
Report Issued by:	NCIA Pendulum Friction Tester Laboratory	**Issue Date:**	05/06/2026
Test Officer	Hong Lu	**Authorised by:**	Hong Lu

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Test Report – Product Certification

Sample Number	2606051733	**TestSheetNumber**	YDU18022A-260605	**Date of Test**	05/06/2026
Tile Name	~~Dural Monument P4~~ (Size: 300×300×6.3 mm)	**Tile Code**	YDU18022A	**Report Number**	R260042
Tile Manufacturer	National Ceramic Industries Australia (NCIA) www.ncia.com.au		**ABN**	83 100 467 267	
Address	175 Racecourse Rd, Rutherford, NSW 2320		**Phone**	02 4931 8400	

Testing performed in Accordance with AS4586-2013 Amd 1:2017, Appendix A Wet Pendulum Test Method with a 96 Rubber slider, conditioned with P400C paper dry, followed by 3 µm wet lapping film

Temperature (Laboratory):	20.0°C	**Testing Instrument:**	Pendulum Friction Tester (Munro Stanley Portable Skid Resistance Tester S/N: 2081) Calibration Date: 18 December 2025

Test Specimen (Unfixed)	**Slope of Surface**	**Cleaning Pre-testing**	**Pendulum Swing Results (BPN)**					**Mean (BPN)** (last3swings)	**Classification According to AS4586-2013**
			1	**2**	**3**	**4**	**5**		
Tile 1	Flat and level surface	Water & Scrubbing	46	46	46	46	46	46	**P4**
Tile 2		Water & Scrubbing	45	45	45	45	45	45	
Tile 3	Same as above	Water & Scrubbing	45	45	45	45	45	45	
Tile 4	Same as above	Water & Scrubbing	45	45	45	45	45	45	**Reported Slip Resistance Value of Sample (BPN)** 45
Tile 5	Same as above	Water & Scrubbing	45	45	45	45	45	45	

Slope Correction Value (SCV) = No
Results relate only to the items tested

Test Location:	NCIA Tile Testing Laboratory, 175 Racecourse Rd, Rutherford, NSW, 2320 Australia		
Report Issued by:	NCIA Pendulum Friction Tester Laboratory	**Issue Date:**	05/06/2026
Test Officer	Hong Lu	**Authorised by:**	Hong Lu

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Test Report – Product Certification

Sample Number	2606051449	**TestSheetNumber**	YDU16322A-260605	**Date of Test**	05/06/2026
Tile Name	Dural Eucalypt P4 (Size: 300×300×6.3 mm)	**Tile Code**	YDU16322A	**Report Number**	R260044
Tile Manufacturer	National Ceramic Industries Australia (NCIA) www.ncia.com.au		**ABN**	83 100 467 267	
Address	175 Racecourse Rd, Rutherford, NSW 2320		**Phone**	02 4931 8400	

Testing performed in Accordance with AS4586-2013 Amd 1:2017, Appendix A Wet Pendulum Test Method with a 96 Rubber slider, conditioned with P400C paper dry, followed by 3 µm wet lapping film

Temperature (Laboratory):	20.0°C	**Testing Instrument:**	Pendulum Friction Tester (Munro Stanley Portable Skid Resistance Tester S/N: 2081) Calibration Date: 18 December 2025

Test Specimen (Unfixed)	**Slope of Surface**	**Cleaning Pre-testing**	**Pendulum Swing Results (BPN)**					**Mean (BPN)** (last3swings)	**Classification According to AS4586-2013**
			1	**2**	**3**	**4**	**5**		
Tile 1	Flat and level surface	Water & Scrubbing	49	49	49	49	49	49	**P4**
Tile 2	Same as above	Water & Scrubbing	48	48	48	48	48	48	
Tile 3	Same as above	Water & Scrubbing	49	49	49	49	49	49	
Tile 4	Same as above	Water & Scrubbing	48	48	48	48	48	48	**Reported Slip Resistance Value of Sample (BPN)** 48
Tile 5	Same as above	Water & Scrubbing	47	47	47	47	47	47	

Slope Correction Value (SCV) = No
Results relate only to the items tested

Test Location:	NCIA Tile Testing Laboratory, 175 Racecourse Rd, Rutherford, NSW, 2320 Australia		
Report Issued by:	NCIA Pendulum Friction Tester Laboratory	**Issue Date:**	05/06/2026
Test Officer	Hong Lu	**Authorised by:**	Hong Lu