Meta Stone



JAPAN CERAMICS

26 Daisy Street
Revesby NSW 2212
P 02 9772 2088
E sales@japanceramics.com.au
japanceramics.com.au

META STONE

26 Daisy Street
Revesby NSW 2212
P 02 9772 2088
E sales@japanceramics.com.au
japanceramics.com.au

COLOURS, FORMATS & FINISHES

White


Sand


Grigio

In/Out | P4

	White	Sand	Grigio
600 x 1200mm	●	●	●
600 x 600mm	●	●	●
300 x 600mm	●	●	●
300 x 300mm	●	●	●
75 x 300mm	●	●	●
404 x 356mm Arrowhead	●	●	●

Textured | P5

600 x 600mm 2CM Paver	●	●	●
398 x 600mm Coping Paver	●	●	●




FINISH: **IN**/**OUT** | CATEGORY: PORCELAIN TILES | EDGE DETAIL: RECTIFIED | V RATING: V2

FINISH: **TEXTURED** | CATEGORY: PORCELAIN TILES | EDGE DETAIL: RECTIFIED | V RATING: V2



Colour variation is an inherent property of all kiln-fired products. Tiles supplied may vary from samples provided. All slip ratings are provided subject to the guidelines outlined in our terms and conditions.

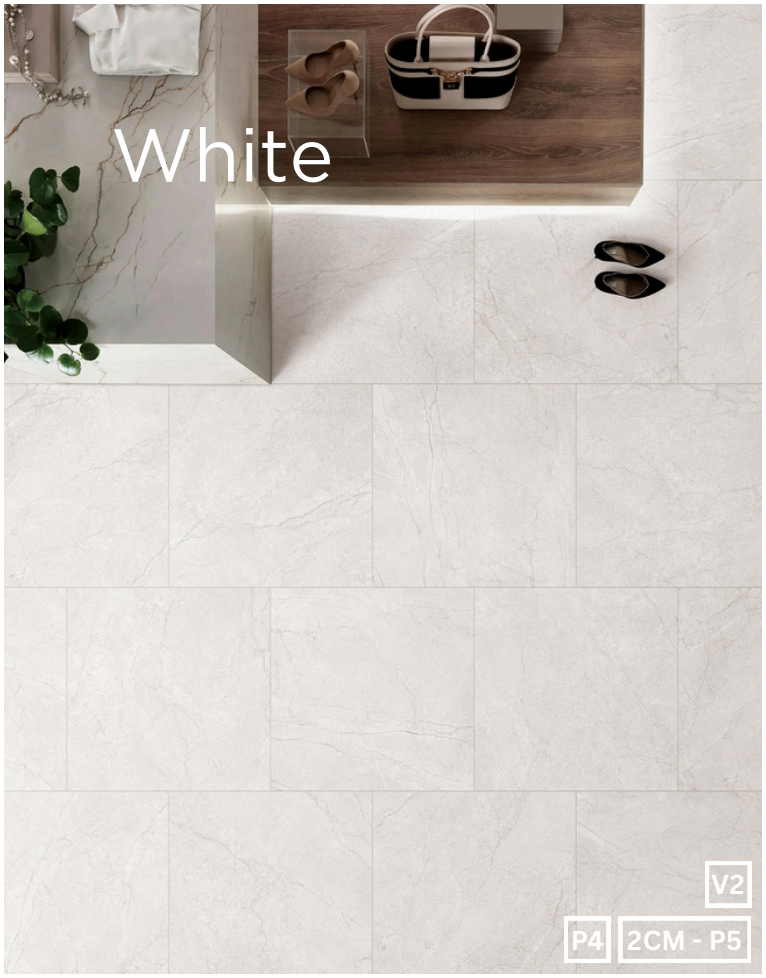

600 x 600mm
METWH60 (in/out)
METWH60-20 (textured 2CM)

600 x 1200mm
METWH612 (in/out)



404 x 356mm (sheet size)
METWHX (in/out)

75 x 300mm
METWH7530 (in/out)

300 x 300mm
METWH30 (in/out)

398 x 600mm Coping
METWH46-20L (textured 2CM)

300 x 600mm
METWH36 (in/out)





600 x 600mm
METSA60 (in/out)
METSA60-20 (textured 2CM)



600 x 1200mm
METSA612 (in/out)




404 x 356mm (sheet size)
METSAX (in/out)

75 x 300mm
METSA7530 (in/out)

300 x 300mm
METSA30 (in/out)



398 x 600mm Coping
METSA46-20L (textured 2CM)



300 x 600mm
METSA36 (in/out)

JAPAN CERAMICS





600 x 600mm
METGR60 (in/out)
METGR60-20 (textured 2CM)



600 x 1200mm
METGR612 (in/out)



404 x 356mm (sheet size)
METGRX (in/out)



75 x 300mm
METGR7530 (in/out)



300 x 300mm
METGR30 (in/out)



398 x 600mm Coping
METGR46-20L (textured 2CM)



300 x 600mm
METGR36 (in/out)



JAPAN CERAMICS

Technical Specifications

Properties	Test Method	Required Value	Value	Applies to
Water absorption	EN ISO 10545-3	⩽ 0.5%	⩽ 0.5%	Full range
Determination of dimensions	EN ISO 10545-2	Length and width ± 0.6% Thickness ± 5.00% Transmutation ± 0.5%	Length and width ± 0.1% Thickness ± 3% Transmutation ± 0.2%	Full range
Breaking strength	EN ISO 10545-4	⩾ 1300 N	⩾ 1300 N	Full range
Modulus of Rupture	EN ISO 10545-4	⩾ 35 N/mm2	⩾ 35 N/mm2	Full range
Abrasion resistance	EN ISO 10545-7	⩽ 205mm2	⩽ 160mm2	Full range
Slip resistance (wet pendulum test)	AS 4586-2013/ AMDT1-2017	N/A	P5 P4	Textured In/Out
Chemical resistance	EN ISO 10545-13	Min. GB	Pass	Full range
Stain resistance	ISO 10545-14	Min class 3	Pass	Full range
Origin	N/A	N/A	China	Full range
Shade variation	N/A	N/A	V2	Full range



JAPAN CERAMICS

Packing Information

Tile Description		Quantity per Box	Quantity per m2		Quantity per Pallet	
Size (mm)	Finish	Pieces	Pieces	Weight	m2	Boxes
Arrowhead Mosaic	In/Out	10	0.12	2.6	N/A	56
75 x 300	In/Out	36	44.44	22.22kg	58.32	72
300 x 300	In/Out	11	11.11	22.00kg	55.44	56
300 x 600	In/Out	8	5.56	21.18kg	57.60	40
398 x 600 Coping Paver	Textured	2	4.19	46.88kg	N/A	64
600 x 600	In/Out	4	2.78	21.18kg	57.60	40
600 x 600 2CM Paver	Textured	2	2.78	46.53kg	28.80	40
600 x 1200	In/Out	2	1.39	23.61kg	57.60	40



The data and information contained in these specification sheets are indicative only unless stated otherwise. As Japan Ceramics cannot control the conditions under which these products are manufactured, the specifications supplied should be considered as suggested guidelines only and are subject to batch variation. The information contained in these specification sheets should not be considered a warranty, expressed or implied, including, but not limited to, a warranty of merchantability or fitness for a particular purpose. To the maximum extent permitted by law, ColorTile will not be responsible for damages of any nature resulting from the use or reliance upon the information contained in this data sheet. No express or implied warranties are given in respect of any specification provided herein other than those that cannot be excluded under the Australian Consumer Law.

JAPAN CERAMICS

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Check to AS 4586-2013

Meta Stone In/Out

Report Number: R35714
Report Date: 9 June 2026
Total Number of Pages 2

Safe Environments quality management system is certified to ISO 9001:2015

Accredited for compliance with ISO/IEC 17025 – Testing

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates

This test report shall not be reproduced unless in full, without written approval of Safe Environments Pty Limited

Issued by	Prepared for	Approved by
Safe Environments Pty Limited 6/7 Inglewood Place Norwest NSW 2153	Japan Ceramics 26 Daisy Street Revesby NSW 2212	B Wright Brooke Wright Authorised Signatory

SlipCheck
CREATING SAFE ENVIRONMENTS
www.FloorSlipTest.com.au

6/7 Inglewood Place
Norwest NSW 2153
Phone02 9621 3706
info@SafeEnvironments.com.au

9 June 2026

Test Report No. R35714

Slip Resistance ClassificationofNewPedestrianSurface Materials

AS 4586-2013 Appendix A (Wet Pendulum Test)

The slip resistance classification has been determined for unused surfaces under specific conditions. Factors such as usage, cleaning systems, applied coatings and patterns of wear may affect the characteristics of the surface after classification. Standards Australia Handbook 198:2014 *Guide to the specification and testing of slip resistance of pedestrian surfaces* provides guidance for the selection of slip resistant pedestrian surfaces classified in accordance with AS 4586-2013. It is recommended that this test report be read in conjunction with AS 4586, HB 197 & HB 198.

Requested by:	Japan Ceramics
Client Address:	26 Daisy Street Revesby NSW 2212
Product Manufacturer:	Foshan Padua Ceramics
Product Description:	Meta Stone In/Out
Test conducted according to:	AS 4586:2013 Appendix A
Sampling Procedures:	Performed by client and tested as received.
Location:	6/7 Inglewood Place, Norwest NSW 2153
Conducted by:	Nathan Vanderburg
Date:	05 June 2026
Sample:	Unfixed
Rubber slider used:	Slider 96
Slope of specimen:	Tested on a flat level surface
Direction of Test:	N/A
Temperature:	19 C
Cleaning:	None
Conditioned:	Grade P 400 paper dry followed by wet lapping film

	Specimen 1	Specimen 2	Specimen 3	Specimen 4	Specimen 5
Mean BPN of last 3 swings:	49	46	49	49	49

Reported SRV of Sample:	**48**
Class:	**P4**

The expanded uncertainty (U_{95}) at the 95% level of confidence with a coverage factor (k) of 2 has been estimated to be 3 BPN or 8%, whichever is the greater; sampling uncertainty has not been included. The expanded uncertainty should be considered when interpreting results or assessing conformity. Results relate only to items tested.

This test report shall not be reproduced unless in full, without written approval of Safe EnvironmentsPtyLtd

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Check to AS 4586-2013

Meta Stone Paver (20mm) 600x600

Report Number: R36364
Report Date: 8 October 2026
Total Number of Pages 2

Safe Environments quality management system is certified to ISO 9001:2015

Accredited for compliance with ISO/IEC 17025 – Testing

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates

This test report shall not be reproduced unless in full, without written approval of Safe Environments Pty Limited

Issued by

Safe Environments Pty Limited
6/7 Inglewood Place
Norwest NSW 2153

Prepared for

Japan Ceramics
26 Daisy Street
Revesby NSW 2212

Approved by

Carl Strautins
Authorised Signatory

SlipCheck
CREATING SAFE ENVIRONMENTS
www.FloorSlipTest.com.au

6/7 Inglewood Place
Norwest NSW 2153
Phone02 9621 3706
info@SafeEnvironments.com.au

8 October 2026

Test Report No. R36364

Slip Resistance ClassificationofNewPedestrianSurface Materials

AS 4586-2013 Appendix A (Wet Pendulum Test)

The slip resistance classification has been determined for unused surfaces under specific conditions. Factors such as usage, cleaning systems, applied coatings and patterns of wear may affect the characteristics of the surface after classification. Standards Australia Handbook 198:2014 *Guide to the specification and testing of slip resistance of pedestrian surfaces* provides guidance for the selection of slip resistant pedestrian surfaces classified in accordance with AS 4586-2013. It is recommended that this test report be read in conjunction with AS 4586, HB 197 & HB 198.

Requested by:	Japan Ceramics
Client Address:	26 Daisy Street Revesby NSW 2212
Product Manufacturer:	Foshan Padua Ceramics
Product Description:	Meta Stone Paver (20mm) 600x600
Test conducted according to:	AS 4586:2013 Appendix A
Sampling Procedures:	Performed by client and tested as received.
Location:	6/7 Inglewood Place, Norwest NSW 2153
Conducted by:	Nathan Vanderburg
Date:	08 October 2026
Sample:	Unfixed
Rubber slider used:	Slider 96
Slope of specimen:	Tested on a flat level surface
Direction of Test:	N/A
Temperature:	22°C
Cleaning:	None
Conditioned:	Grade P 400 paper dry followed by wet lapping film

	Specimen 1	Specimen 2	Specimen 3	Specimen 4	Specimen 5
Mean BPN of last 3 swings:	75	75	75	73	74

Reported SRV of Sample:	**74**
Class:	**P5**

The expanded uncertainty (U_{95}) at the 95% level of confidence with a coverage factor (k) of 2 has been estimated to be 3 BPN or 8%, whichever is the greater; sampling uncertainty has not been included. The expanded uncertainty should be considered when interpreting results or assessing conformity. Results relate only to items tested.

This test report shall not be reproduced unless in full, without written approval of Safe EnvironmentsPtyLtd