Pietra



JAPAN CERAMICS

26 Daisy Street
Revesby NSW 2212
P 02 9772 2088
E sales@japanceramics.com.au
japanceramics.com.au

PIETRA

COLOURS, FORMATS & FINISHES


Matt | P3	White	Cream	Ivory	Beige	Terra	Silver	Grigio	Antracite	Black
600 x 1200mm	●	●	●	●	●	●	●	●	●
600 x 600mm	●	●	●	●	●	●	●	●	●
300 x 600mm	●	●	●	●	●	●	●	●	●
300 x 300mm	●	●	●	●	●	●	●	●	●
260 x 300mm Chevron	●	●	●	●	●	●	●	●	●
50 x 300mm	●	●	●	●	●	●	●	●	●
50 x 50mm Mosaic	●	●	●	●	●	●	●	●	●

Textured | P5									
300 x 600mm	●	●	●	●	●	●	●	●	●
600 x 600mm	●	●	●	●	●	●	●	●	●

FINISH: **MATT** | CATEGORY: PORCELAIN TILES | EDGE DETAIL: RECTIFIED | V RATING: V3
FINISH: **TEXTURED** | CATEGORY: PORCELAIN TILES | EDGE DETAIL: RECTIFIED | V RATING: V3



Colour variation is an inherent property of all kiln-fired products. Tiles supplied may vary from samples provided. All slip ratings are provided subject to the guidelines outlined in our terms and conditions.

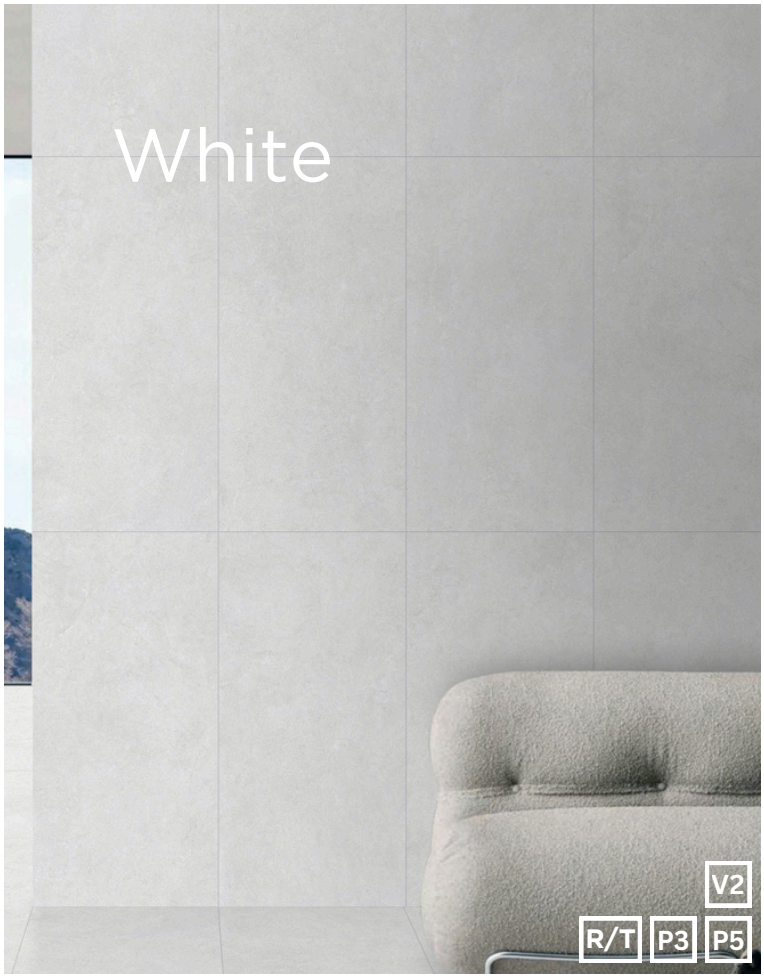

600 x 600mm
PIETWH60 (matt)
PIETWH60T (textured)

600 x 1200mm
PIETWH612 (matt)

50 x 300mm
PIETWH530 (matt)

Chevron Mosaic
PIETWHCV (matt)

Square Mosaic
PIETWHX (matt)

300 x 300mm
PIEYWH30 (matt)

300 x 600mm
PIETWH36 (matt)
PIETWH36T (textured)



600 x 600mm
PIETCR60 (matt)
PIETCR60T (textured)

600 x 1200mm
PIETCR612 (matt)

50 x 300mm
PIETCR530 (matt)

Chevron Mosaic
PIETCRCV (matt)

Square Mosaic
PIETCRX (matt)

300 x 300mm
PIETCR30 (matt)

300 x 600mm
PIETCR36 (matt)
PIETCR36T (textured)

JAPAN CERAMICS



600 x 600mm
PIETIV60 (matt)
PIETIV60T (textured)

600 x 1200mm
PIETIV612 (matt)

50 x 300mm
PIETIV530 (matt)

Chevron Mosaic
PIETIVCV (matt)

Square Mosaic
PIETIVX (matt)

300 x 300mm
PIETIV30 (matt)

300 x 600mm
PIETIV36 (matt)
PIETIV36T (textured)



600 x 600mm
PIETBE60 (matt)
PIETBE60T (textured)

600 x 1200mm
PIETBE612 (matt)

50 x 300mm
PIETBE530 (matt)

Chevron Mosaic
PIETBECV (matt)

Square Mosaic
PIETBEX (matt)

300 x 300mm
PIETBE30 (matt)

300 x 600mm
PIETBE36 (matt)
PIETBE36T (textured)

JAPAN CERAMICS





600 x 600mm
PIETTE60 (matt)
PIETTE60T (textured)



600 x 1200mm
PIETTE612 (matt)



50 x 300mm
PIETTE30 (matt)



Chevron Mosaic
PIETTECV (matt)



Square Mosaic
PIETTEX (matt)



300 x 300mm
PIETTE30 (matt)



300 x 600mm
PIETTE36 (matt)
PIETTE36T (textured)



600 x 600mm
PIETSI60 (matt)
PIETSI60T (textured)

600 x 1200mm
PIETSI612 (matt)

50 x 300mm
PIETSI530 (matt)

Chevron Mosaic
PIETSICV (matt)

Square Mosaic
PIETSIX (matt)



300 x 300mm
PIETSI30 (matt)

300 x 600mm
PIETSI36 (matt)
PIETSI36T (textured)

JAPAN CERAMICS





600 x 600mm
PIETGR60 (matt)
PIETGR60T (textured)



600 x 1200mm
PIETGR612 (matt)



50 x 300mm
PIETGR530 (matt)



Chevron Mosaic
PIETGRCV (matt)



Square Mosaic
PIETGRX (matt)



300 x 300mm
PIETGR30 (matt)



300 x 600mm
PIETGR36 (matt)
PIETGR36T (textured)





600 x 600mm
PIETAT60 (matt)
PIETAT60T (textured)



600 x 1200mm
PIETAT612 (matt)



50 x 300mm
PIETAT530 (matt)



Chevron Mosaic
PIETATCV (matt)



Square Mosaic
PIETATX (matt)



300 x 300mm
PIETAT30 (matt)



300 x 600mm
PIETAT36 (matt)
PIETAT36T (textured)

JAPAN CERAMICS





600 x 600mm
PIETBK60 (matt)
PIETBK60T (textured)



600 x 1200mm
PIETBK612 (matt)



50 x 300mm
PIETBK530 (matt)




Chevron Mosaic
PIETBKCV (matt)



Square Mosaic
PIETBKX (matt)



300 x 300mm
PIETBK30 (matt)



300 x 600mm
PIETBK36 (matt)
PIETBK36T (textured)



JAPAN CERAMICS

Technical Specifications

Properties	Test Method	Required Value	Value	Applies to
Water absorption	EN ISO 10545-3	⩽ 0.5%	<3%	Full range
Determination of dimensions	EN ISO 10545-2	Length and width ± 0.6% Thickness ± 5.00% Transmutation ± 0.5%	Length and width± 0.6% Thickness ± 5.00% Transmutation ± 0.1%	Full range
Breaking strength	EN ISO 10545-4	⩾ 1100 N	⩾ 1606 N	Full range
Modulus of rupture	EN ISO 10545-4	⩾ 35 N/mm2	⩾ 37.3 N/mm2	Full range
Abrasion resistance	EN ISO 10545-7	⩽ 205mm2	⩽ 160mm2	Full range
Slip resistance (wet pendulum test)	AS 4586-2013/ AMDT1-2017	N/A	P3 - Matt P5 - Textured	Matt, Textured
Chemical resistance	EN ISO 10545-13	Min. GB	Class 5	Full range
Stain resistance	ISO 10545-14	Min class 3	Class 5	Full range
Origin	N/A	N/A	China	Full range
Shade variation	N/A	N/A	V3	Full range



JAPAN CERAMICS

Packing Information

Tile Description		Quantity per Box	Quantity per m2		Quantity per Pallet	
Size (mm)	Finish	Pieces	Pieces	Weight	m2	Boxes
Square Mosaic	Matt	11	-	1.80kg	-	-
Chevron Mosaic 260 x 300	Matt	11	-	1.60kg	-	-
50 x 300	Matt	40	66.67	20.00kg	64.80	108
300 x 300	Matt	11	11.11	20.14kg	55.44	56
300 x 600	Matt Textured	8	5.56	22.22kg	57.60	40
600 x 600	Matt Textured	4	2.78	20.50kg	57.60	40
600 x 1200	Matt	2	1.39	22.22kg	46.08	32



The data and information contained in these specification sheets are indicative only unless stated otherwise. As Japan Ceramics cannot control the conditions under which these products are manufactured, the specifications supplied should be considered as suggested guidelines only and are subject to batch variation. The information contained in these specification sheets should not be considered a warranty, expressed or implied, including, but not limited to, a warranty of merchantability or fitness for a particular purpose. To the maximum extent permitted by law, ColorTile will not be responsible for damages of any nature resulting from the use or reliance upon the information contained in this data sheet. No express or implied warranties are given in respect of any specification provided herein other than those that cannot be excluded under the Australian Consumer Law.

JAPAN CERAMICS

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Check to AS 4586-2013

Pietra

Report Number: R34242
Report Date: 31 July 2025
Total Number of Pages 2

Safe Environments quality management system is certified to ISO 9001:2015

Accredited for compliance with ISO/IEC 17025 – Testing

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates

This test report shall not be reproduced unless in full, without written approval of Safe Environments Pty Limited

Issued by

Safe Environments Pty Limited
6/7 Inglewood Place
Norwest NSW 2153

Prepared for

Japan Ceramics Pty Ltd
26 Daisy Street
Revesby NSW 2212

Approved by

Ratan Venkatesan
Authorised Signatory

info@SafeEnvironments.com.au
www.SafeEnvironments.com.au

SlipCheck
CREATING SAFE ENVIRONMENTS
www.FloorSlipTest.com.au

6/7 Inglewood Place
Norwest NSW 2153
Phone02 9621 3706
info@SafeEnvironments.com.au

31 July 2025

Test Report No. R34242

Slip Resistance ClassificationofNewPedestrianSurface Materials

AS 4586-2013 Appendix A (Wet Pendulum Test)

The slip resistance classification has been determined for unused surfaces under specific conditions. Factors such as usage, cleaning systems, applied coatings and patterns of wear may affect the characteristics of the surface after classification. Standards Australia Handbook 198:2014 *Guide to the specification and testing of slip resistance of pedestrian surfaces* provides guidance for the selection of slip resistant pedestrian surfaces classified in accordance with AS 4586-2013. It is recommended that this test report be read in conjunction with AS 4586, HB 197 & HB 198.

Requested by:	Japan Ceramics Pty Ltd
Client Address:	26 Daisy Street Revesby NSW 2212
Product Manufacturer:	WenZhou J & F Foreign Trade Co.,Ltd
Product Description:	Pietra
Test conducted according to:	AS 4586:2013 Appendix A
Sampling Procedures:	Performed by client and tested as received.
Location:	6/7 Inglewood Place, Norwest NSW 2153
Conducted by:	Ratan Venkatesan

Date:	31 July 2025	Temperature:	15°C
Sample:	Unfixed	Cleaning:	None
Rubber slider used:	Slider 96	Conditioned:	Grade P 400 paper dry followed by wet lapping film
Slope of specimen:	Tested on a flat level surface		
Direction of Test:	N/A		

	Specimen 1	Specimen 2	Specimen 3	Specimen 4	Specimen 5
Mean BPN of last 3 swings:	50	51	49	49	50

Reported SRV of Sample:	**50**
Class:	**P4**

The expanded uncertainty (U_{95}) at the 95% level of confidence with a coverage factor (k) of 2 has been estimated to be 3 BPN or 8%, whichever is the greater; sampling uncertainty has not been included. The expanded uncertainty should be considered when interpreting results or assessing conformity. Results relate only to items tested.

This test report shall not be reproduced unless in full, without written approval of Safe EnvironmentsPtyLtd

IMPORTANT NOTE:
Slip ratings are indicative only. Actual performance may vary depending on installation, surface conditions, and maintenance.

Slip Check to AS 4586-2013

Pietra Textured

Report Number: R35511d
Report Date: 1 May 2026
Total Number of Pages 2

Safe Environments quality management system is certified to ISO 9001:2015

Accredited for compliance with ISO/IEC 17025 – Testing

NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration, inspection, proficiency testing scheme providers and reference materials producers reports and certificates

This test report shall not be reproduced unless in full, without written approval of Safe Environments Pty Limited

Issued by

Safe Environments Pty Limited
6/7 Inglewood Place
Norwest NSW 2153

Prepared for

Japan Ceramics Pty Ltd
26 Daisy Street
Revesby NSW 2212

Approved by

Carl Strautins
Authorised Signatory

SlipCheck
CREATING SAFE ENVIRONMENTS
www.FloorSlipTest.com.au

6/7 Inglewood Place
Norwest NSW 2153
Phone02 9621 3706
info@SafeEnvironments.com.au

1 May 2026

Test Report No. R35511d

Slip ResistanceClassificationofNewPedestrianSurface Materials

AS 4586-2013 Appendix A (Wet Pendulum Test)

The slip resistance classification has been determined for unused surfaces under specific conditions. Factors such as usage, cleaning systems, applied coatings and patterns of wear may affect the characteristics of the surface after classification. Standards Australia Handbook 198:2014 *Guide to the specification and testing of slip resistance of pedestrian surfaces* provides guidance for the selection of slip resistant pedestrian surfaces classified in accordance with AS 4586-2013. It is recommended that this test report be read in conjunction with AS 4586, HB 197 & HB 198.

Requested by:	Japan Ceramics Pty Ltd
Client Address:	26 Daisy Street Revesby NSW 2212
Product Manufacturer:	Wenahou J And F Foreign Trade CoLtd
Product Description:	Pietra Textured
Test conducted according to:	AS 4586:2013 Appendix A
Sampling Procedures:	Performed by client and tested as received.
Location:	6/7 Inglewood Place, Norwest NSW 2153
Conducted by:	Nathan Vanderburg
Date:	30 April 2026
Sample:	Unfixed
Rubber slider used:	Slider 96
Slope of specimen:	Tested on a flat level surface
Direction of Test:	N/A
Temperature:	22°C
Cleaning:	None
Conditioned:	Grade P 400 paper dry followed by wet lapping film

	Specimen 1	Specimen 2	Specimen 3	Specimen 4	Specimen 5
Mean BPN of last 3 swings:	65	65	65	67	67

Reported SRV of Sample:	**65**
Class:	**P5**

The expanded uncertainty (U_{95}) at the 95% level of confidence with a coverage factor (k) of 2 has been estimated to be 3 BPN or 8%, whichever is the greater; sampling uncertainty has not been included. The expanded uncertainty should be considered when interpreting results or assessing conformity. Results relate only to items tested.

This test report shall not be reproduced unless in full, without written approval of Safe EnvironmentsPtyLtd